

**EVALUATION REPORT OF
METAL SALES MANUFACTURING CORPORATION
'24 GA. MAGNA-LOC PANEL'**

**FLORIDA BUILDING CODE 5TH EDITION (2014)
FLORIDA PRODUCT APPROVAL
FL 11560.7-R2
ROOFING
METAL ROOFING**

**Prepared For:
Metal Sales Manufacturing Corporation
545 South 3rd Street, Suite 200
Louisville, KY 40202
Telephone: (502) 855-4300
Fax: (502) 855-4290**

**Prepared By:
Bala Sockalingam, Ph.D., P.E.
Florida Professional Engineer #62240
1216 N Lansing Ave., Suite C
Tulsa, OK 74106
Telephone: (918) 492-5992
FAX: (866) 366-1543**

**This report consists of
Evaluation Report (2 Pages including cover)
Installation Details (2 Pages)**

**Report No. C2009-7
Date: 3.30.15**



Manufacturer: Metal Sales Manufacturing Corporation

Product Name: Magna-Loc

Panel Description: Standing seam panel with 16" wide coverage and 2" high ribs

Materials: Min. 24 ga., 50 ksi steel. Galvanized coated steel (ASTM A653) or Galvalume coated steel (ASTM A792) or painted steel (ASTM A755).

Deck Description: Min. 22 ga., Grade 80 B-deck. The deck and its attachment to supports must be designed by other to carry the panel loads.

Insulation: 4" thick (max.) rigid board insulation

Slope: 1/4:12 or greater in accordance with FBC 2014 Section 1507.4.2

Design Uplift Pressure: 59.7 psf @ MC 1203 clip spacing of 36" o.c.
168.5 psf @ MPW-1203-8 clip spacing of 12" o.c.


Panel Attachment: MC 1203 clip with (2) #14-13 deck screws per clip through 4" x 5" x 20 ga. bearing plate and rigid insulation into deck.
MPW-1203-8 clip with (4) #14-13 deck screws per clip through 4" x 5" x 20 ga. bearing plate and rigid insulation into deck.
Fastener shall be of sufficient length to penetrate through the deck a minimum of 1/2".

Test Standards: Roof assembly tested in accordance with TAS 125-03 'Standard Requirements for Metal Roofing Systems'.

Code Compliance: The product described herein has demonstrated compliance with FBC 2014 Section 1507.4

Product Limitations: Design wind loads shall be determined for each project in accordance with FBC 2014 Section 1609 or ASCE 7-10 using allowable stress design. The maximum fastener spacing listed herein shall not be exceeded. This evaluation report is not applicable in High Velocity Hurricane Zone. Fire classification is not within scope of this Evaluation Report. Refer to FBC 2014 Section 1505 and current approved roofing materials directory or ASTM E108/UL790 report from an accredited laboratory for fire ratings of this product.

Supporting Documents: TAS 125 Test Report
Farabaugh Engineering and Testing Inc
Project No. T293-14, Reporting Date 9/5/14

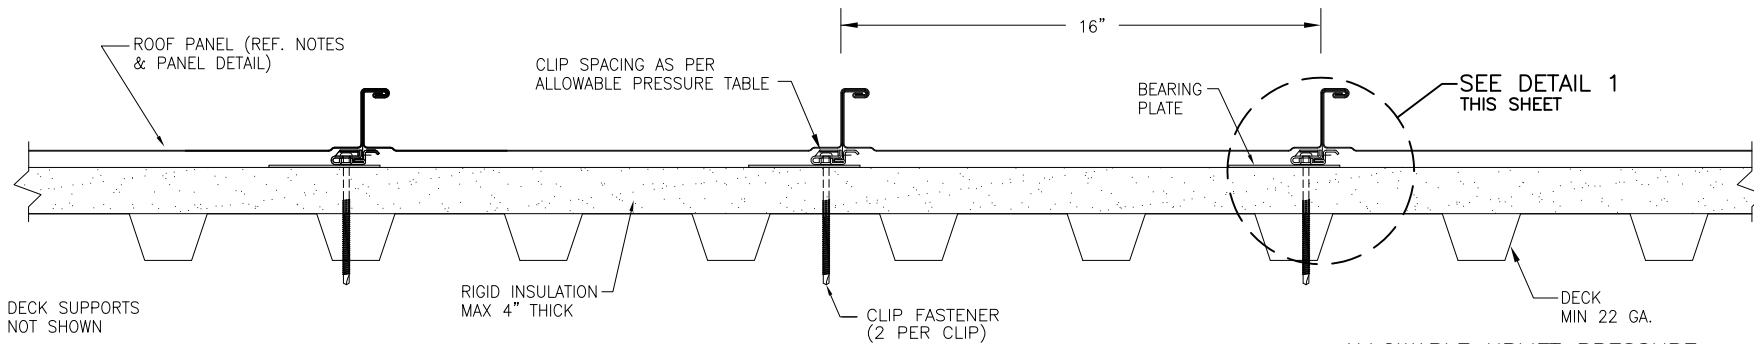

DECK SUPPORTS NOT SHOWN

RIGID INSULATION MAX 4" THICK


CLIP FASTENER (2 PER CLIP)

DECK MIN 22 GA.


TYPICAL PANEL INSTALLATION X-SECTION

ALLOWABLE UPLIFT PRESSURE

CLIP TYPE	CLIP SPACING	PRESSURE (PSF)
MC 1203	36"	59.7

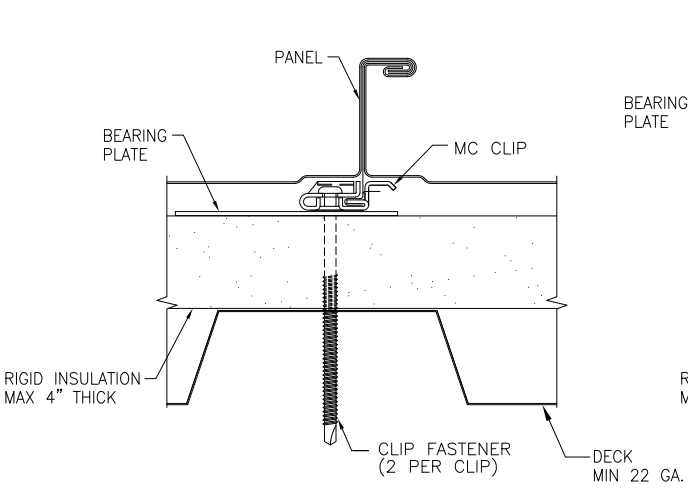


CLIP SECTION VIEW

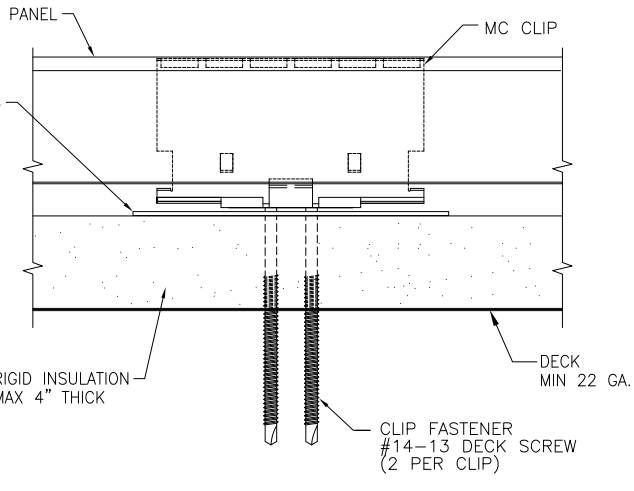

CLIP SIDE VIEW

DETAIL 1

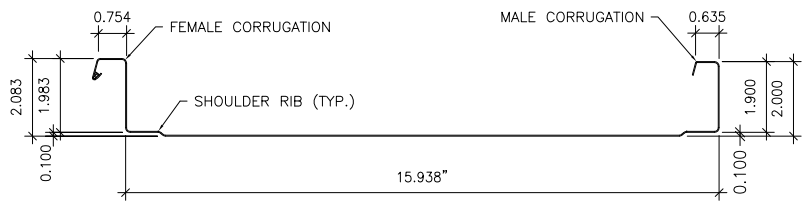


PANEL SECTION
(MIN 24 GA.)


GENERAL NOTES:

1. ARCHITECTURAL STANDING SEAM ROOF PANEL HAS BEEN DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE (FBC).
2. ROOF PANELS SHALL BE MIN. 24 GA. (t = 0.022"). EFFECTIVE COVERING WIDTH OF PANEL = 16".
3. THE ROOF PANELS SHALL BE INSTALLED OVER STRUCTURE AS SPECIFIED ON THIS DRAWING.
4. REQUIRED DESIGN WIND LOADS SHALL BE DETERMINED FOR EACH PROJECT. THIS PANEL SYSTEM MAY NOT BE INSTALLED WHEN THE REQUIRED DESIGN WIND LOADS ARE GREATER THAN THE ALLOWABLE WIND LOADS SPECIFIED ON THIS DRAWING.
5. CLIPS AND FASTENERS MUST BE IN ACCORDANCE WITH THIS DRAWING & FLORIDA BUILDING CODE. IF A DIFFERENCE OCCURS BETWEEN THE MINIMUM REQUIREMENTS OF THIS DRAWING & THE CODE, THE CODE SHALL CONTROL.
6. DECK AND SUPPORTS MUST BE DESIGNED TO WITHSTAND WIND LOADS AS REQUIRED FOR EACH APPLICATION AND ARE THE RESPONSIBILITY OF OTHERS.


DRAWN BY: B.S.	CHECKED BY: D.S.	PLOT:	DATE: 3/30/15
REVISION NO.	DATE	DESCRIPTION	
DRAWING TITLE: 24 GA. MAGNA-LOC STANDING SEAM PANEL			
CONSULTANTS BALA SOCKALINGAM, PH.D., P.E.		MANUFACTURER METAL SALES MANUFACTURING CORP.	
1216 N LANSING AVE, SUITE C TULSA, OK 74106		545 SOUTH 3RD ST., SUITE 200 LOUISVILLE, KY 40202	
PHONE: 918-492-5992 FAX: 866-366-1543		502-855-4300	
DRAWING NO. 2009-7A	REV.	PAGE NO. 1 OF 2	

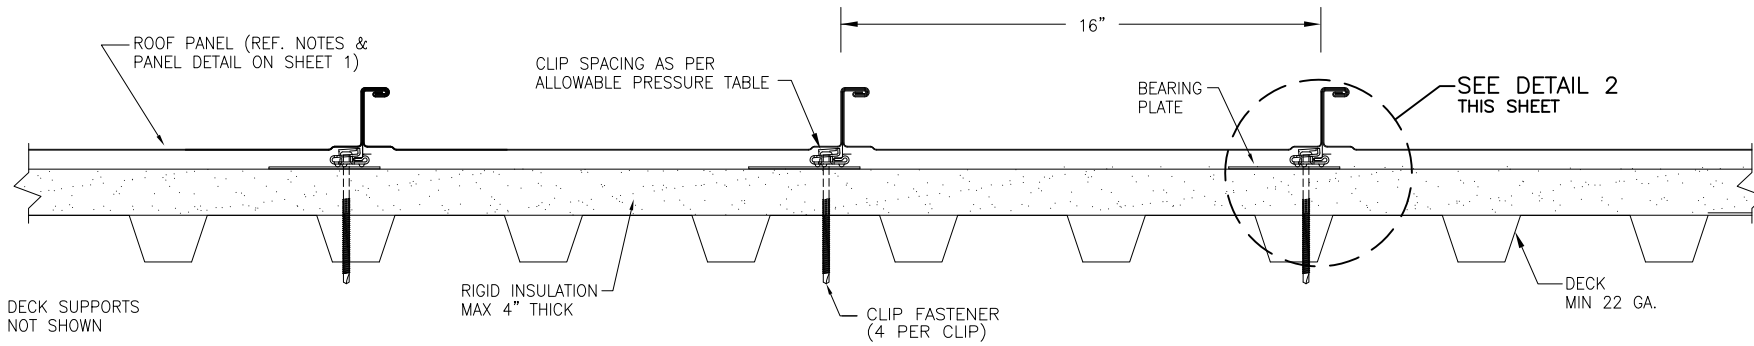

TYPICAL PANEL INSTALLATION X-SECTION

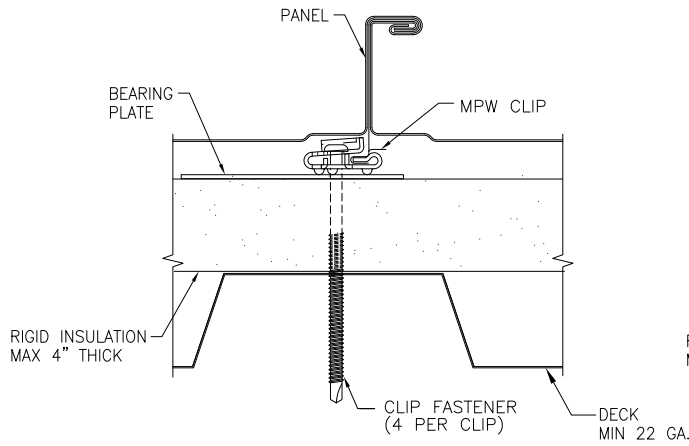

CLIP SECTION VIEW

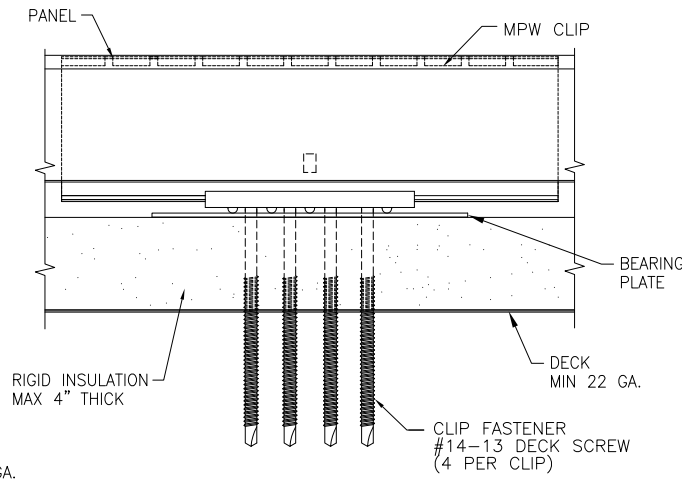

CLIP SIDE VIEW

DETAIL 2

ALLOWABLE UPLIFT PRESSURE

CLIP TYPE	CLIP SPACING	PRESSURE (PSF)
MPW-1203-8	12"	168.5

DRAWN BY: B.S.	CHECKED BY: D.S.
PLLOT:	DATE: 3/30/15
NO.	DATE
BY	
REVISION DESCRIPTION	
<p>DRAWING TITLE 24 GA. MAGNA-LOC STANDING SEAM PANEL</p> <p>CONSULTANTS BALA SOCKALINGAM, PH.D., P.E. 1216 N LANSING AVE, SUITE C TULSA, OK 74106 PHONE: 918-492-5992 FAX: 866-366-1943</p> <p>MANUFACTURER METAL SALES MANUFACTURING CORP. 545 SOUTH 3RD ST., SUITE 200 LOUISVILLE, KY 40202 502-855-4300</p>	
<p>DRAWING NO. 2009-7B</p> <p>PAGE NO. 2 OF 2</p>	