

**EVALUATION REPORT OF  
METAL SALES MANUFACTURING CORPORATION  
'24 GA., 7/8" CORRUGATED PANEL'**


**FLORIDA BUILDING CODE 5<sup>TH</sup> EDITION (2014)  
FLORIDA PRODUCT APPROVAL  
FL 9482.1-R4  
PANEL WALLS  
SIDING**

**Prepared For:  
Metal Sales Manufacturing Corporation  
545 South 3<sup>rd</sup> Street, Suite 200  
Louisville, KY 40202  
Telephone: (502) 855-4300  
Fax: (502) 855-4290**

**Prepared By:  
Bala Sockalingam, Ph.D., P.E.  
Florida Professional Engineer #62240  
1216 N Lansing Ave., Suite C  
Tulsa, OK 74106  
Telephone: (918) 492-5992  
FAX: (866) 366-1543**

**This report consists of  
Evaluation Report (2 Pages including cover)  
Installation Details (1 Page)**

**Report No. C2000-10  
Date: 3.24.15**

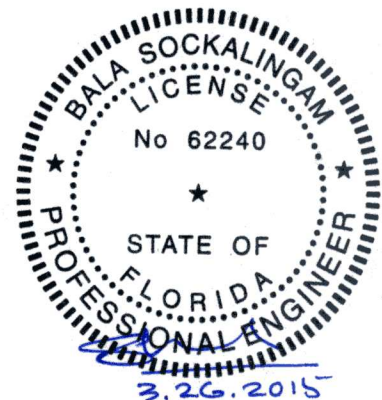

Manufacturer: Metal Sales Manufacturing Corporation

Product Name: 7/8" Corrugated

Panel Description: 34.67" wide coverage with (14) 7/8" high ribs spaced at 2.67" o.c.

Materials: Min 24 ga. 50 ksi steel. Galvanized coated steel (ASTM A653) or Galvalume coated steel (ASTM A792) or painted steel (ASTM A755)

Support Description: Min 16 ga., 50 ksi steel section (Must be designed by others)

Design Pressure:  $\pm 175$  psf @ support spacing of 24" o.c.  
 $\pm 30$  psf @ support spacing of 96" o.c.

Panel Attachment: #12-14 x 1.25" long SDS with washer @ 8" o.c. across panel width


Sidelap Attachment: 1/4"-14 x 7/8" long SDS with washer @ 12" o.c.

Test Standards: Wall assembly tested in accordance with ASTM E330-02 'Standard Test Method for Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference.'

Code Compliance: The product described herein has demonstrated compliance with FBC 2014 Section 1404.5

Product Limitations: Design wind loads shall be determined for each project in accordance with FBC 2014 Section 1609 or ASCE 7-10 using allowable stress design. The maximum support spacing listed herein shall not be exceeded. The design pressure for reduced support spacing may be computed using rational analysis prepared by a Florida Professional Engineer. This evaluation report is not applicable in High Velocity Hurricane Zone.

Supporting Documents: ASTM E330 Test Reports  
Farabaugh Engineering and Testing Inc  
Project No. T170-09, Reporting Date 4/29/09

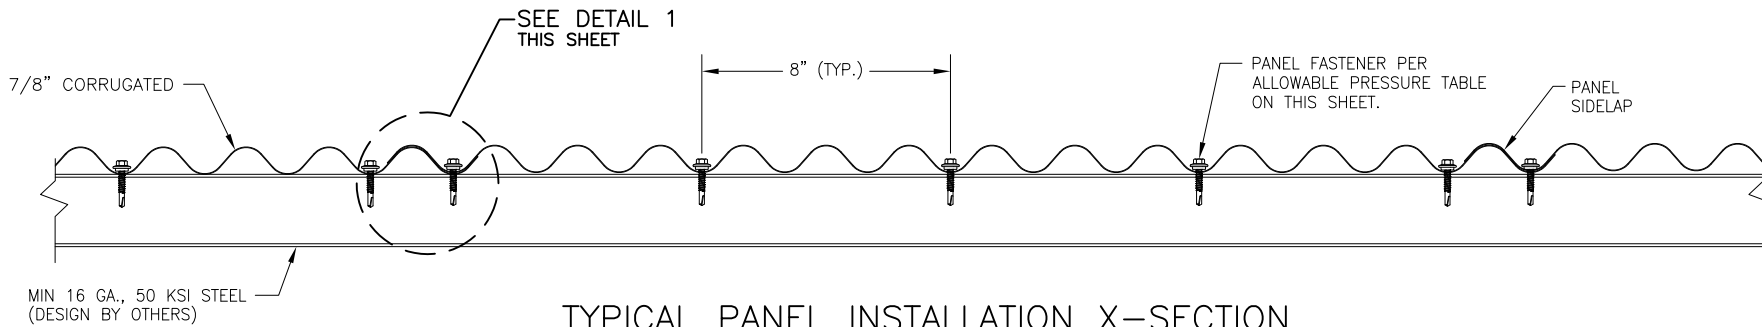


TYPICAL PANEL INSTALLATION X-SECTION

ALLOWABLE PRESSURE


SUPPORT SPACING (IN)	PRESSURE (PSF)
96	30.0
24	175.0

**GENERAL NOTES:**

1. STRUCTURAL WALL PANEL HAS BEEN DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE (FBC).
2. WALL PANELS ARE SHALL BE 24 GA. (0.022"), EFFECTIVE COVERING WIDTH OF PANEL = 34.67".
3. WALL PANELS SHALL BE INSTALLED OVER STRUCTURE AS SPECIFIED ON THIS DRAWING.
4. REQUIRED DESIGN WIND LOADS SHALL BE DETERMINED FOR EACH PROJECT. THIS PANEL SYSTEM MAY NOT BE INSTALLED WHEN THE REQUIRED DESIGN WIND LOADS ARE GREATER THAN THE ALLOWABLE WIND LOADS SPECIFIED ON THIS DRAWING.
5. ALL FASTENERS MUST BE IN ACCORDANCE WITH THIS DRAWING & THE FLORIDA BUILDING CODE. IF A DIFFERENCE OCCURS BETWEEN THE MINIMUM REQUIREMENTS OF THIS DRAWING & THE CODE, THE CODE SHALL CONTROL.
6. SUPPORTS MUST BE DESIGNED TO WITHSTAND WIND LOADS AS REQUIRED FOR EACH APPLICATION AND ARE THE RESPONSIBILITY OF OTHERS.
7. PANELS MAY SPAN BETWEEN BOTTOM AND TOP SUPPORTS (WALL APPLICATION WITH PANELS ORIENTED VERTICALLY), SIDE TO SIDE BETWEEN CORNER WITH PANELS ORIENTED VERTICALLY), SIDE TO SIDE BETWEEN CORNER SUPPORTS (WALL APPLICATION WITH PANELS ORIENTED HORIZONTALLY) OR UNDER ROOF (SOFFIT APPLICATION WITH PAINTED SURFACE FACING DOWNWARD).

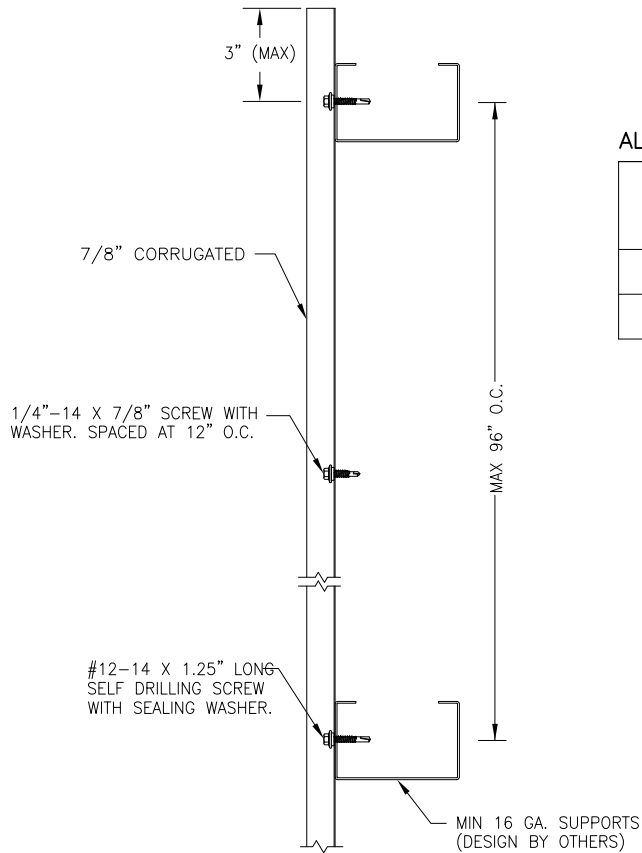

SECTION VIEW

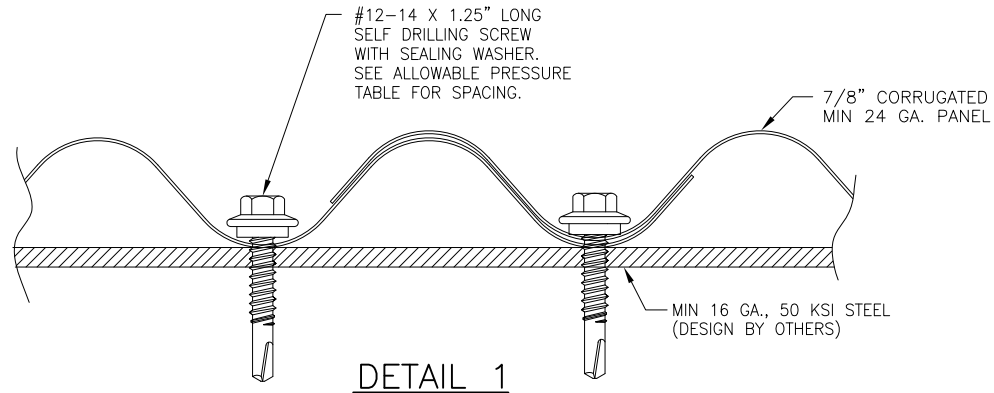

DETAIL 1

DRAWN BY: B.S.	CHECKED BY: D.S.
PLLOT:	DATE: 3/20/15
DATE	
BY	
REVISION DESCRIPTION	
NO.	
DRAWING TITLE <b>7/8" CORRUGATED PANEL</b>	
CONSULTANTS <b>BALA SOCKALINGAM, PH.D., P.E.</b>	MANUFACTURER <b>METAL SALES MANUFACTURING CORP.</b>
1216 N LANSING AVE, SUITE C TULSA, OK 74106 PHONE: 918-492-5992	545 SOUTH 3RD ST., SUITE 200 LOUISVILLE, KY 40202 502-855-4300
DRAWING NO. <b>2000-10</b>	REV. 1
PAGE NO. 1	OF 1